


LEGEND

- PWR-PRIM EXISTING 230kV TRANSMISSION LINE
- PWR-PRIM EXISTING 138kV TRANSMISSION LINE
- PWR-PRIM EXISTING 72kV TRANSMISSION LINE
- PWR-PRIM EXISTING OVERHEAD DISTRIBUTION LINE
- PWR-UG EXISTING UNDERGROUND DISTRIBUTION LINE
- SPC-FIBRE EXISTING SPC FIBRE OPTIC CABLE
- PIPELINE EXISTING PIPELINE
- - - PROPOSED GL7 REBUILD 72kV (138kV) - PHASE 1
- - - PROPOSED GL7 REBUILD/REROUTE 72kV (138kV) - PHASE 2

CONSTRAINTS

- CROWN LAND
- RESERVE LAND
- AVOIDANCE AREA
- OCCUPIED RURAL RESIDENCE (RED DENOTES 45m MINIMUM AVOIDANCE BUFFER) (YELLOW DENOTES 160m AVOIDANCE BUFFER)

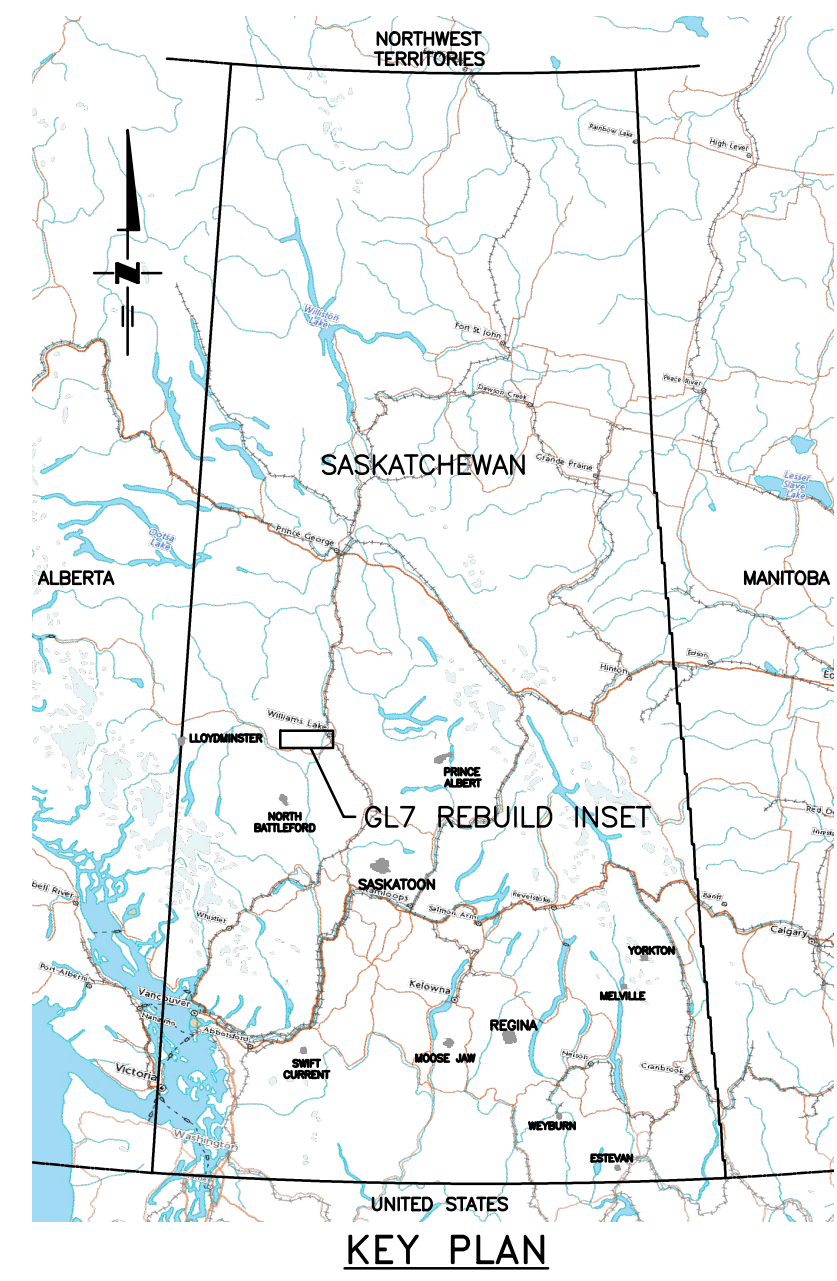

IMAGERY INFO:
 NRCAN WMS TOPORAMA
 CONTAINS INFORMATION LICENSED UNDER THE OPEN GOVERNMENT LICENCE - CANADA.
<https://open.canada.ca/en/open-government-licence-canada>

DISCLAIMER

THIS DRAWING WAS PREPARED FOR SASKATCHEWAN POWER CORPORATION ("SaskPower") FOR ITS SPECIFIC INTERNAL PURPOSES ONLY. SaskPower DOES NOT WARRANT THAT THE DRAWING IS COMPLETE, ACCURATE OR CORRECT, NOR DOES IT WARRANT THAT THE DRAWING IS REPRESENTATIVE OF MATTERS DEPICTED THEREIN AS AT THE DATE OF THE REPRESENTATIONS OR WARRANTIES WITH REGARD TO THE ADEQUACY OR SUITABILITY OF THIS DRAWING FOR ANY PURPOSE WHATSOEVER.

SaskPower SHALL NOT BE RESPONSIBLE OR LIABLE TO ANY PERSON IN RESPECT OF ANY LOSS, DAMAGE OR INJURY WHETHER DIRECT OR INDIRECT, ARISING OUT OF THE USE OF OR RELIANCE ON THIS DRAWING, IN WHOLE OR IN PART.

NOT FOR CONSTRUCTION

AutoCAD

DESIGNED BY	ENGINEERING SEAL.	DRAFTING DEPT.
DRAWN BY		DRAWN BY C. ISAAC
APPR'D BY		CHECKED BY
SEALED BY		DATE (Y-M-D) 2021-08-10
DATE (Y-M-D)		DESIGN DEPT.
		DESIGNED BY S. PILUK
		CHECKED BY S. PILUK
		APPROVED BY
		SEALED BY N/A
		DATE (Y-M-D) 2021-08-10

SaskPower INTERNAL USE ONLY

PROPOSED 72kV (138kV)
 GL7 LINE REBUILD
 GLASLYN - SPIRITWOOD
 KEY PLAN
 GL7 MAP BOOK-P/8891

AUTOCAD SOURCE FILENAME: GL7_MAPBOOK_KEYPLAN_CUSTOM.DWG
PLOT DATE: 2022-06-30 PAPER: D
PLOT TIME: 1:09 PM
PLOTTED BY: CISAC
SCALE: NTS
DRAWING No.
GL7
MAPBOOK
SHEET 1 OF 1
REV.